


## Excavation Instructions

1. Hole shall be excavated to provide a minimum of 12 inches of clearance around tank's perimeter.
2. Bottom of hole will be level and free of large or sharp rocks and compacted.
3. Recommended coverage over tank is approximately 18 inches (to a maximum of 30 inches).


## Backfill Instructions


1. Place tank into hole and level tank.
2. Place 12 inches of water into tank.
3. Backfill material must be clean and free of large or sharp rocks. Should be sand or sand & gravel mixture.
4. Backfill material should be placed in 24 inch, even layers around the tank.
5. Backfill material should be hand or mechanically tamped at each 24 inch layer before the next layer is applied.
6. In case of high water table areas:  
Flotation may be prevented by filling tank half full of water.
7. Equipment should not be operated over any septic system.

## Fitting Installation Instructions

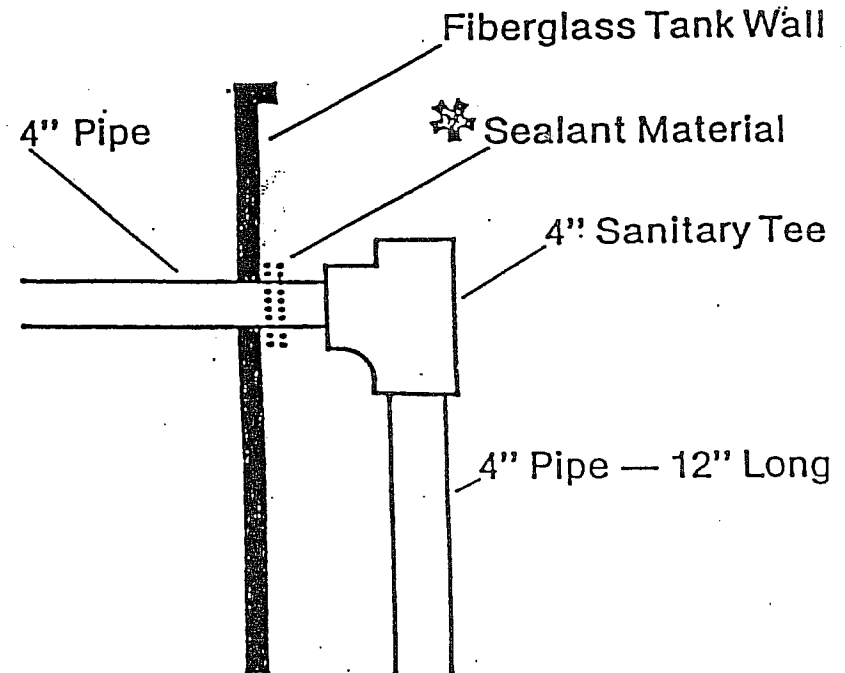

 USE WATERPROOF SILICÓN SEALANT OR WATERPROOF ROOFING PUTTY — 1/2-INCH THICK BEAD.

 WARRANTY WILL NOT BE HONORED IF INSTALLATION INSTRUCTIONS ARE NOT FOLLOWED.



File # 1311

MANUFACTURED BY  
E.C. LOOMIS & SON  
P.O. Box 910  
Arroyo Grande, CA 93421  
(805) 473-7265

SIZE

K-